

Completed By: AL
Date: 6/14/2023

Project No. - 110170064




Figure B. 8: Proposed Upgrades

City of Red Deer Water Model Update
City of Red Deer

**Appendix C Trace Analysis Results for Spilled Contaminant
Migrations**

Figure C.1: Trace Analysis Results for the Water Treatment Plant as the Trace Source under Average Day Demand Scenario

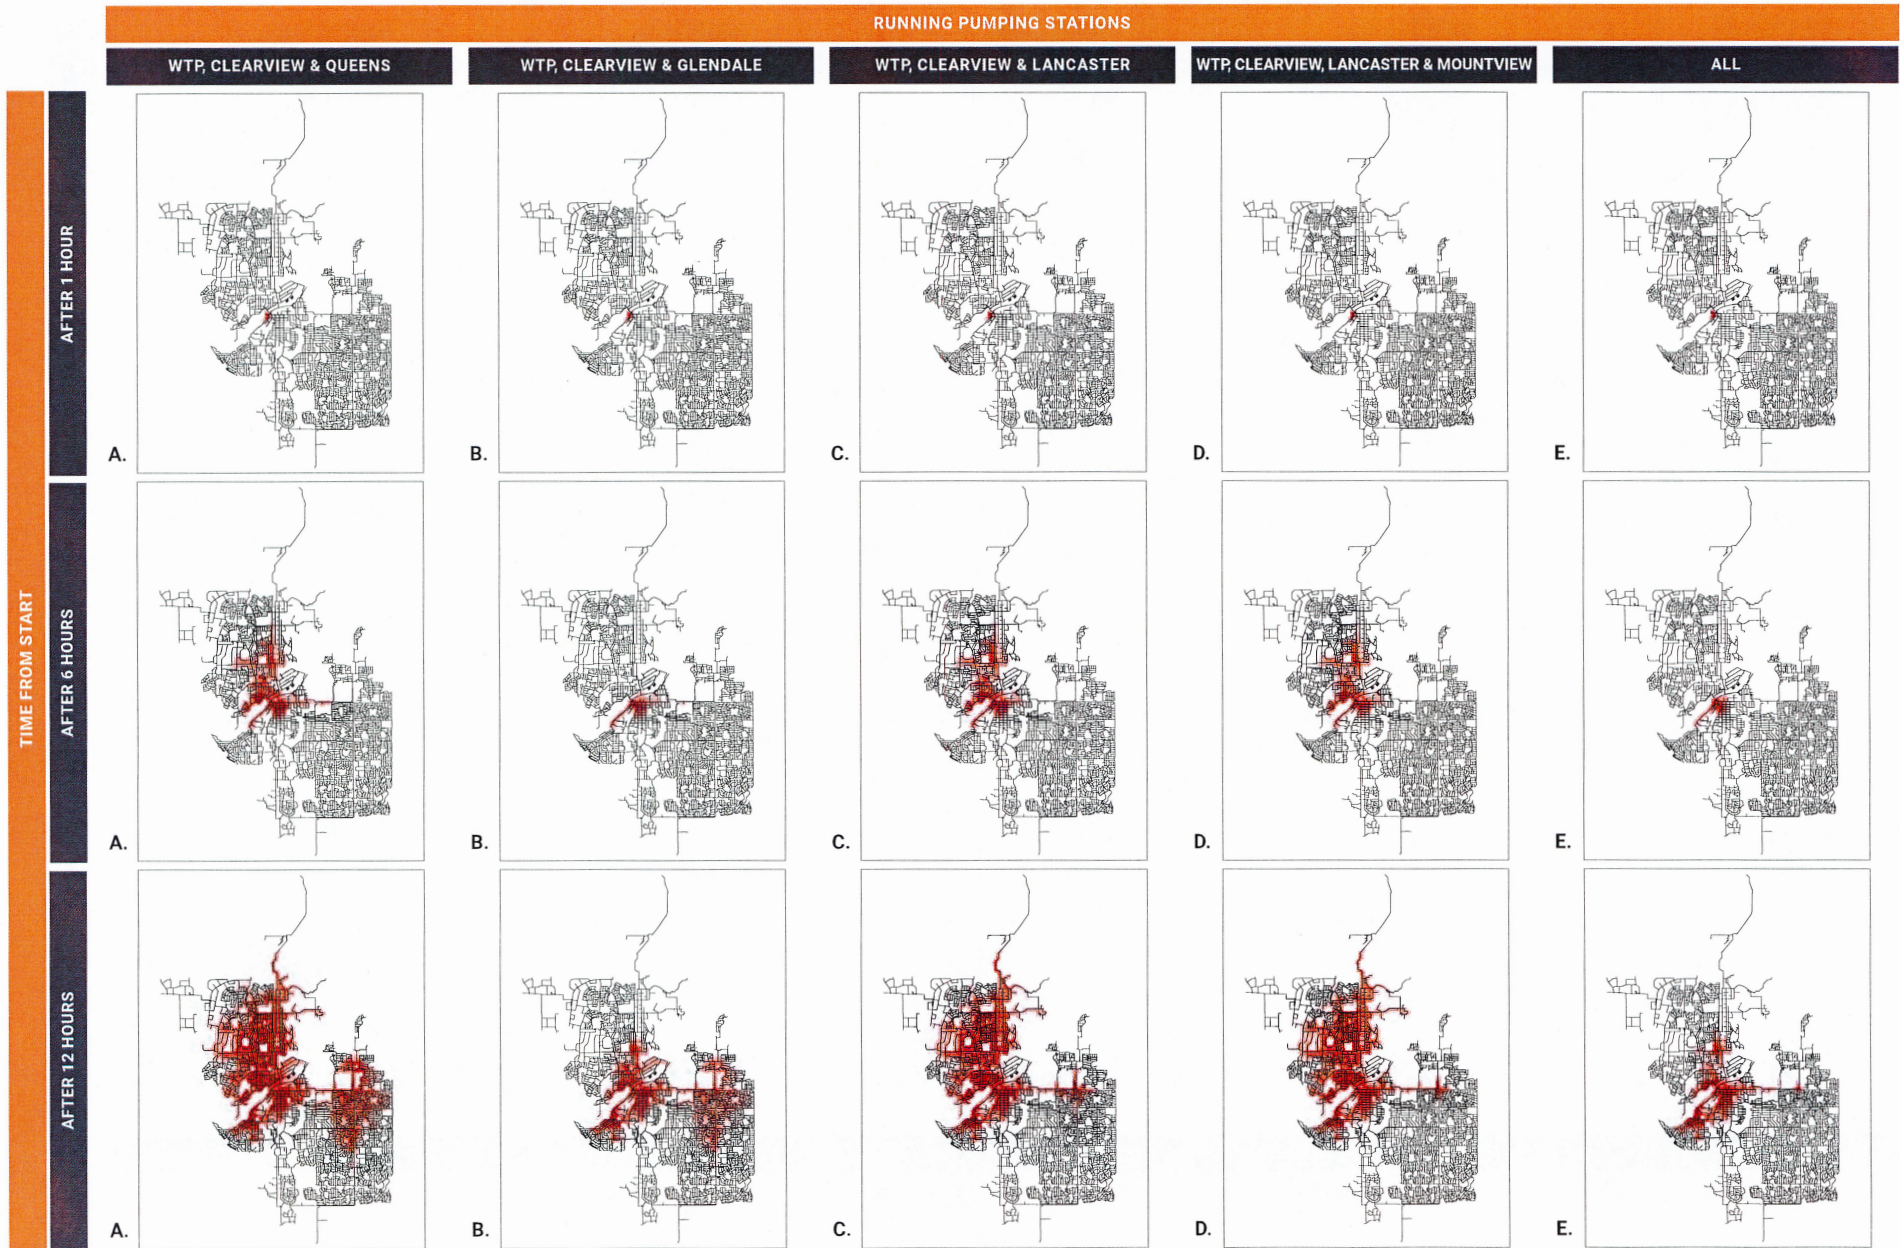


Figure C.2: Trace Analysis Results for the Clearview Pumping Station as the Trace Source under Average Day Demand Scenario

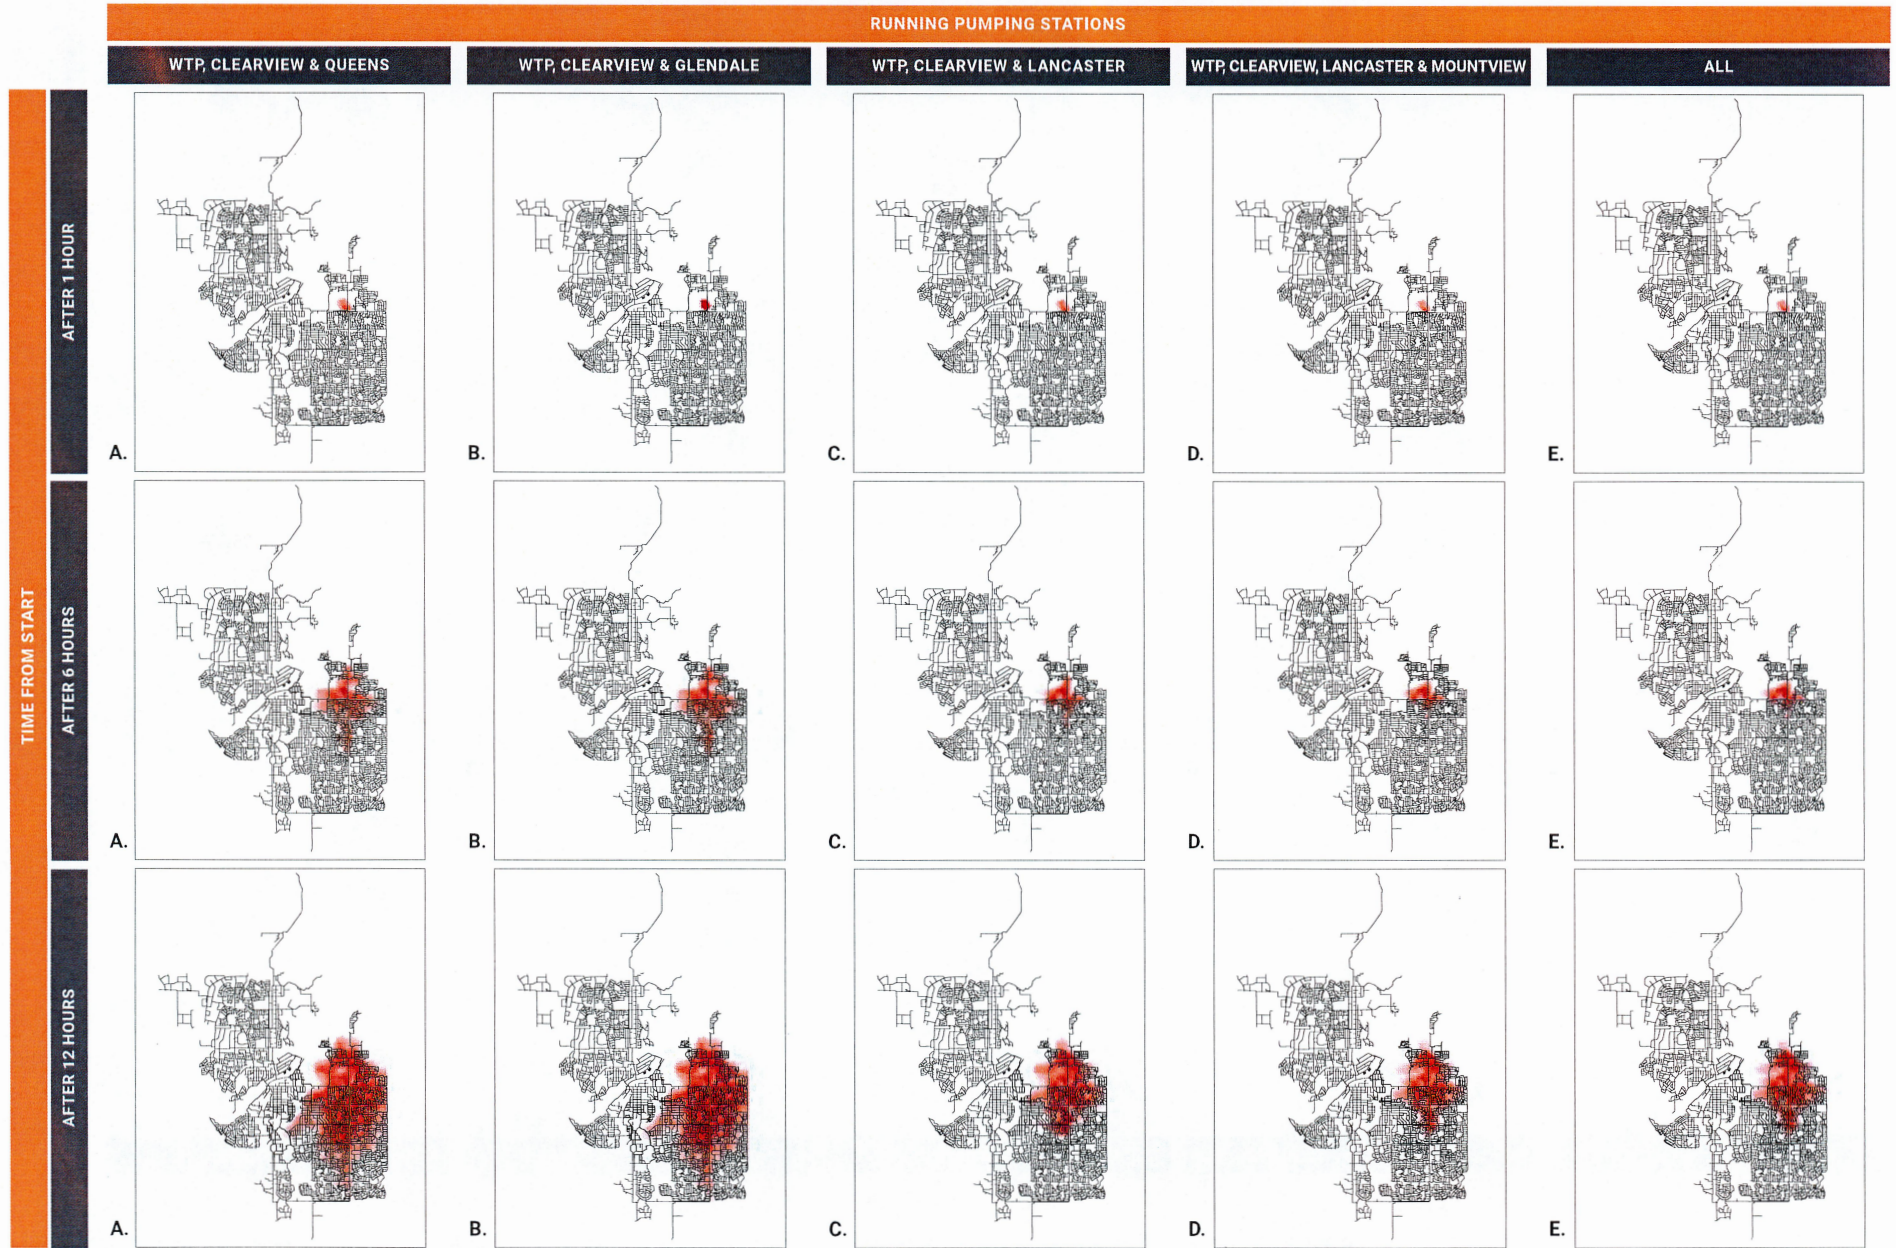


Figure C.3: Trace Analysis Results for the Queens Pump Station as the Trace Source under Average Day Demand Scenario



Figure C.4: Trace Analysis Results for the Glendale Pumping Station as the Trace Source under Average Day Demand Scenario

