


Display: 1d

Energy delivered from the utility to the customer.



Display: 1r

Energy received by the utility from the customer's solar installation or Microgen installation. Displays on all AMI meters.

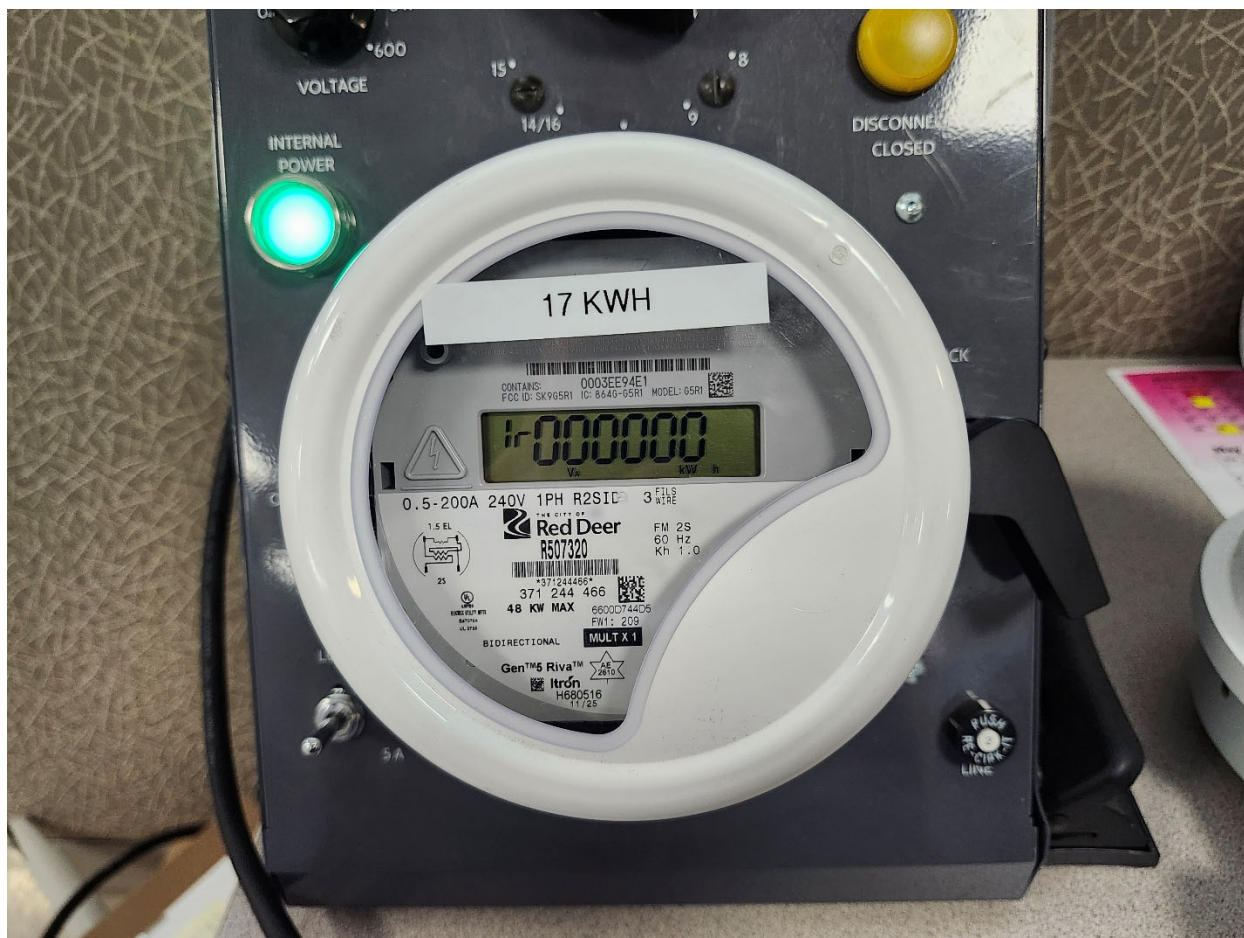

Display: 3d

Peak demand used by the customer in a 15-minute interval over the course of a month. This value is reset every month and is for reference only. It does not result in additional charges. Displays in kVA.



Display: nErE9

Network Registered, device can successfully transact with the BOS.




Display: Segment Check

All LCD components display at once to indicate if LCD segments are not displaying properly.



Display: DS 900

Length of demand interval, measured in seconds (900 seconds = 15 minutes).

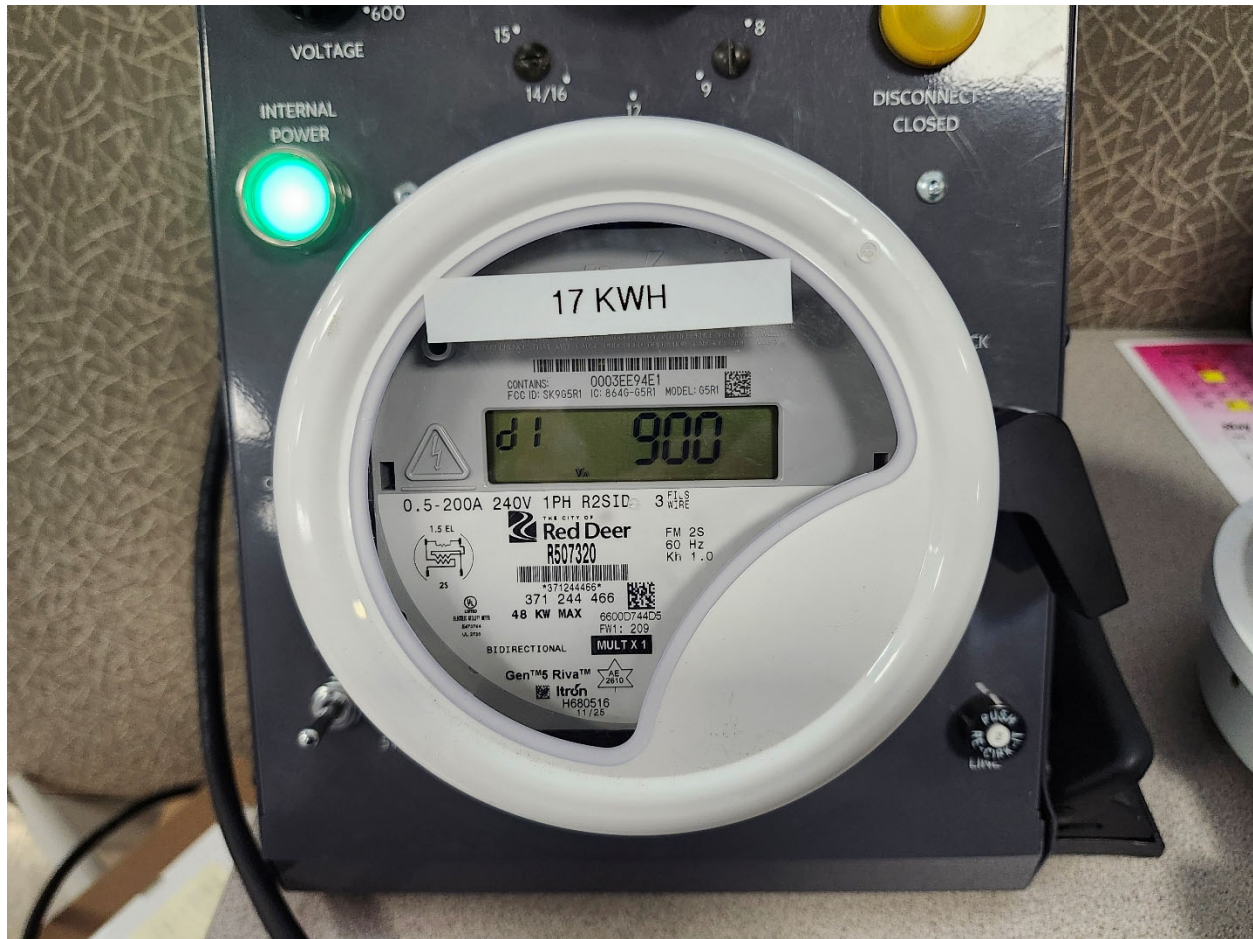

Display: SI 1

Number of sub-intervals in demand interval.

